


監視型調査機器設置箇所図（選別）

1/2

さいたま市

配水管口径別	
75	
100	
125	
150	
200	
250	
300	
350	
400	
450	
500	
600	
800	
1200	
1350	

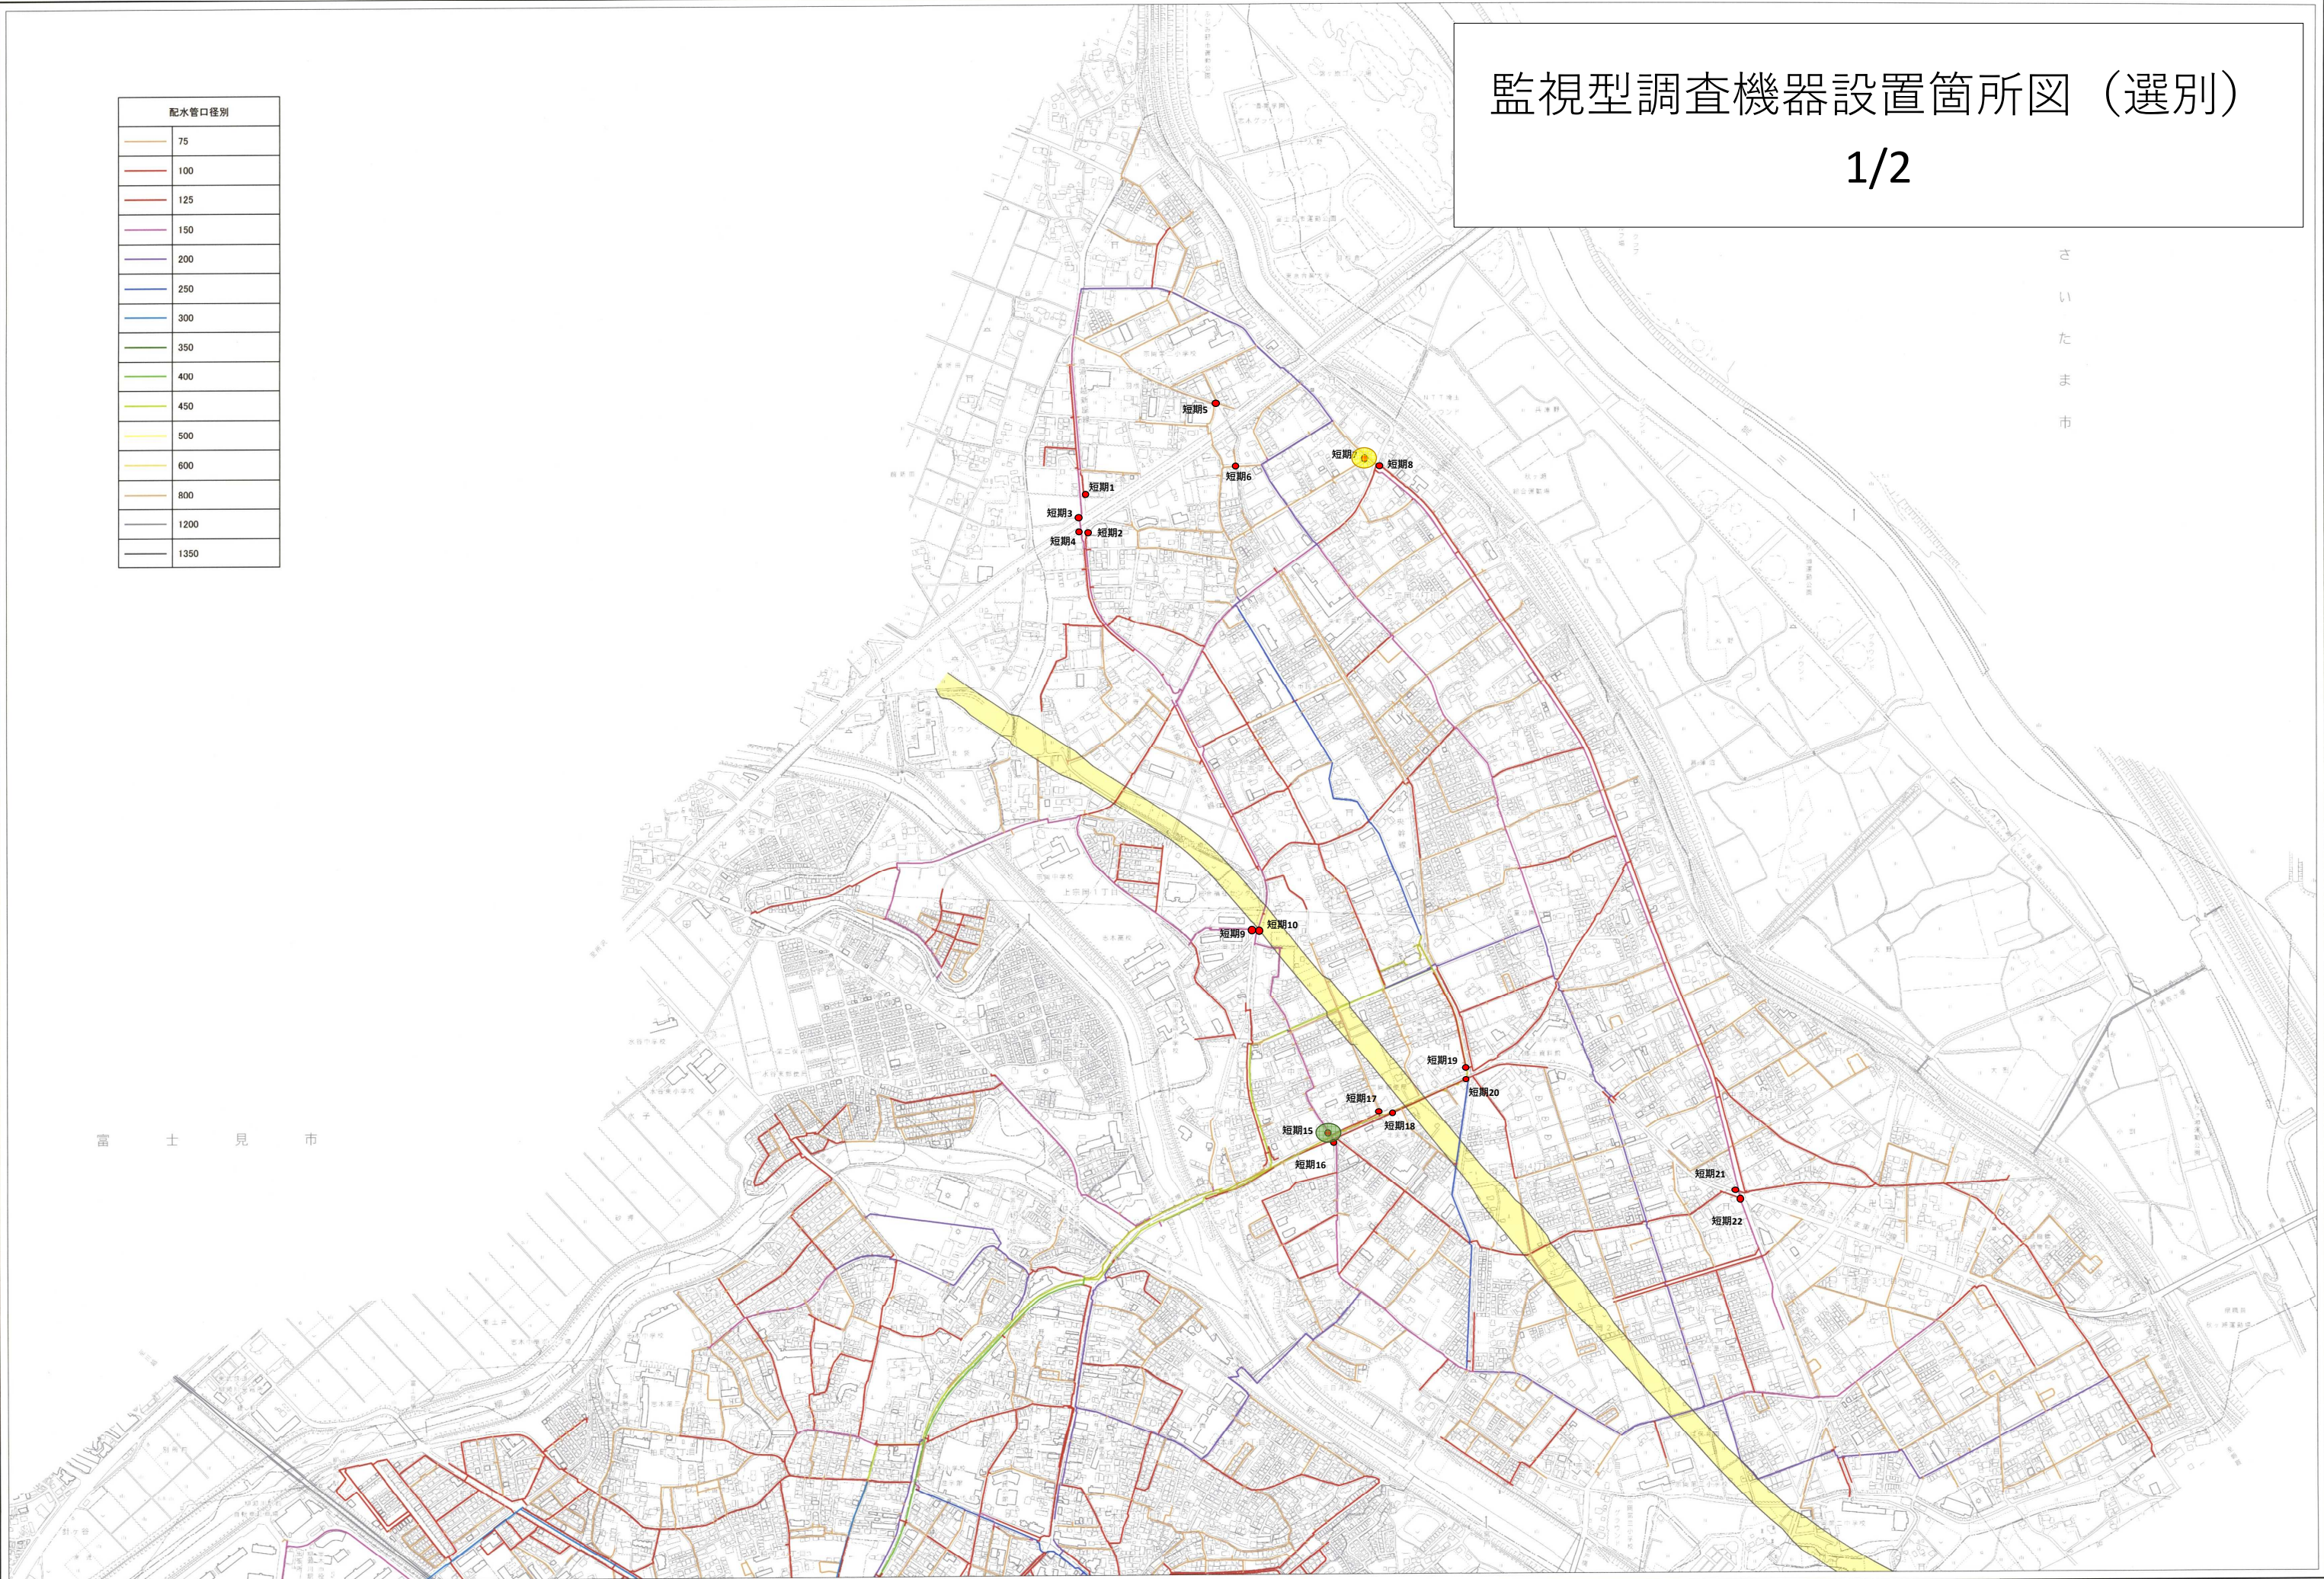

監視型調査機器設置箇所図 (選別)

2/2

幸町・館

下宗岡

配水管口径別	
—	75
—	100
—	125
—	150
—	200
—	250
—	300
—	350
—	400
—	450
—	500
—	600
—	800
—	1200
—	1350

